

# Wilton Fire Department

## Permit Application – Liquid Storage

FEE= \$35.00

Paid Via: \_\_\_\_\_

PERMIT# \_\_\_\_\_

	Permit application to install a <b>LIQUID PROPANE</b> storage container > 100 gallons.
	Permit application to install an <b>OIL</b> storage container > 100 gallons.
	Permit application to <b>PERMANENTLY REMOVE</b> an oil storage container.

Property Address: \_\_\_\_\_ Map/Lot # \_\_\_\_\_

Property Owner: \_\_\_\_\_

Name of Installer: \_\_\_\_\_ GAS LICENSE # \_\_\_\_\_

Expiration Date: \_\_\_\_\_ Gas Fitter's Cell Phone # \_\_\_\_\_

Email: \_\_\_\_\_

**\*INSTALLER SHALL SHOW LICENSE AND PHOTO ID WITH APPLICATION\***

Company Name: \_\_\_\_\_

Address: \_\_\_\_\_ Company Phone # \_\_\_\_\_

Container Capacity: \_\_\_\_\_ Gallons    \_\_\_\_\_ Above Ground    \_\_\_\_\_ Below Ground

Date of Installation: \_\_\_\_\_ Date of Permanent Removal: \_\_\_\_\_

On reverse, show the following details:

OVER ►►►►►►►

- Container Location
- Distance to buildings & lot lines
- Location of roads, driveways, parking lots
- Proposed container protection methods.

\_\_\_\_\_  
Date

\_\_\_\_\_  
Signature of Applicant

I understand my signature verifies installation is compliant with all State NH adopted codes including those adopted by reference. ASME, RSA 135:5, Saf-C 6012, NFPA, UL, CSA America including ANSI Z223.1-2015.

Inspected and Approved

**NOT** Approved


\_\_\_\_\_  
Date: \_\_\_\_\_

Fire Inspector

# Wilton Fire Department

## Permit Application – Liquid Storage

**Please Sketch Diagram:** Reference NFPA 58, NFPA 31.

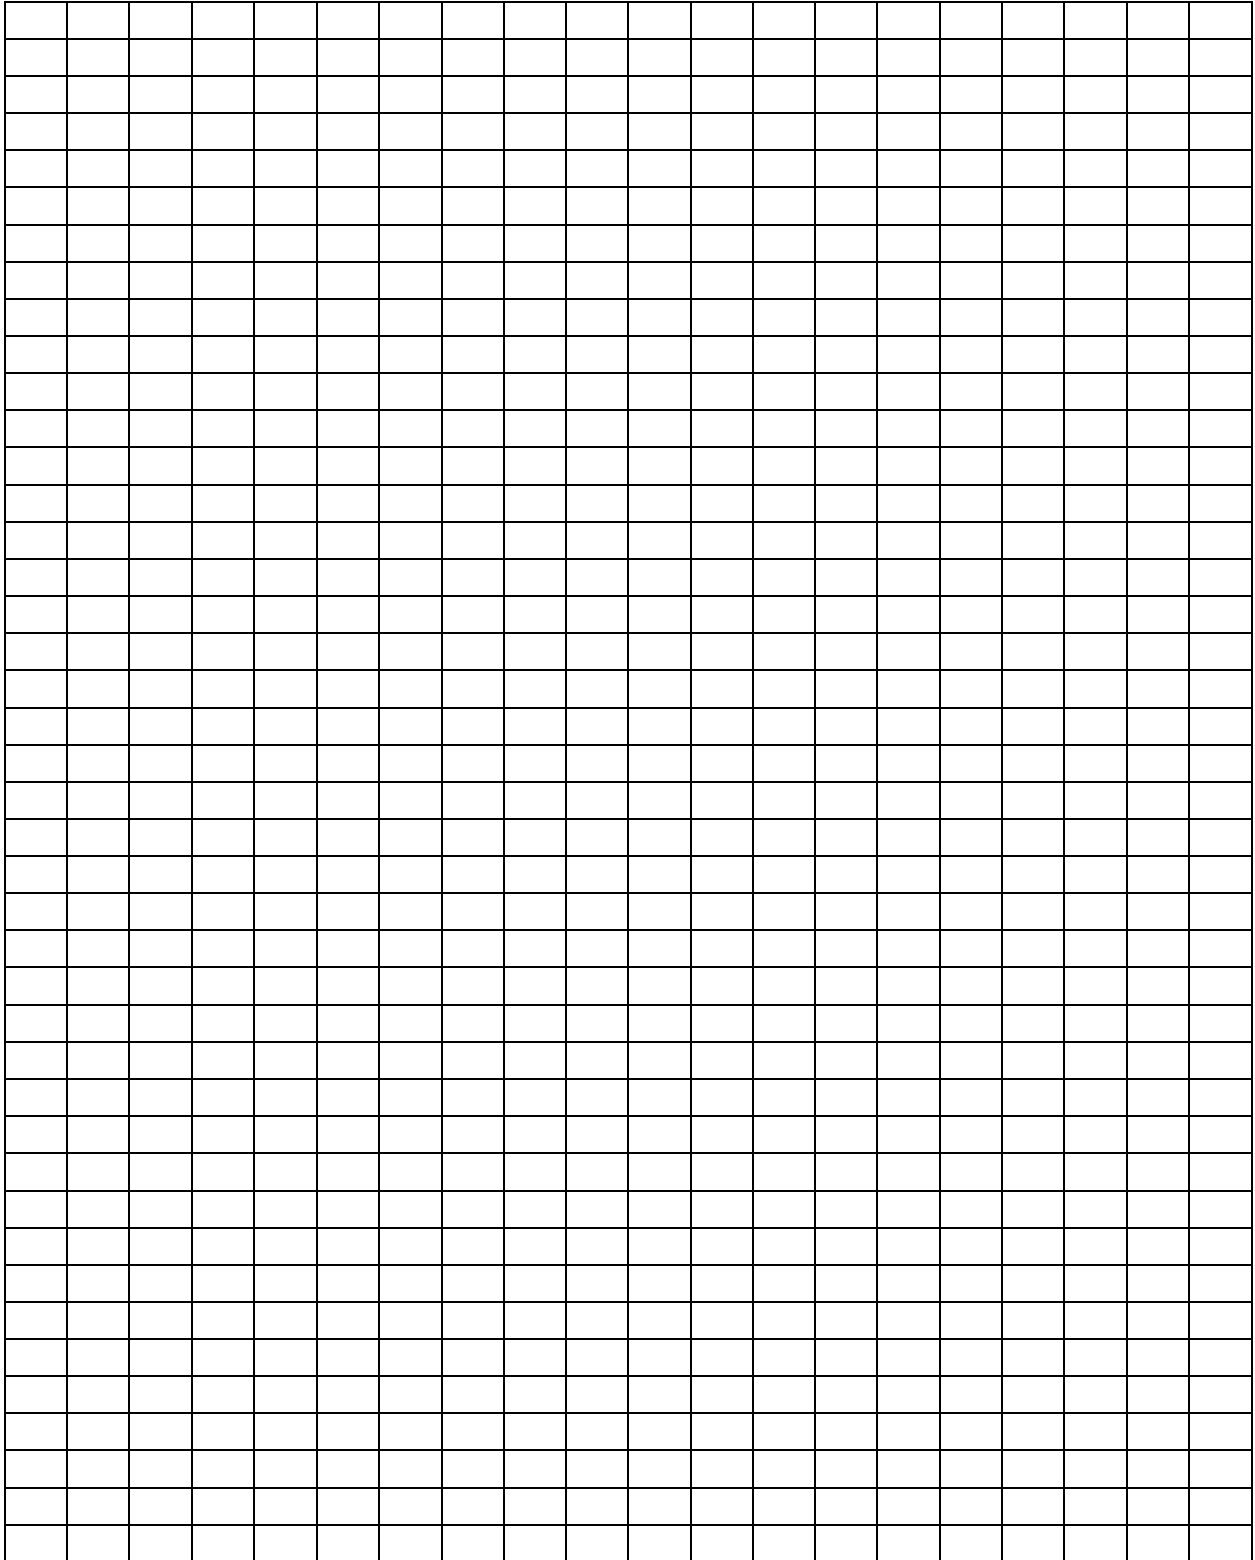

02/01/2021